



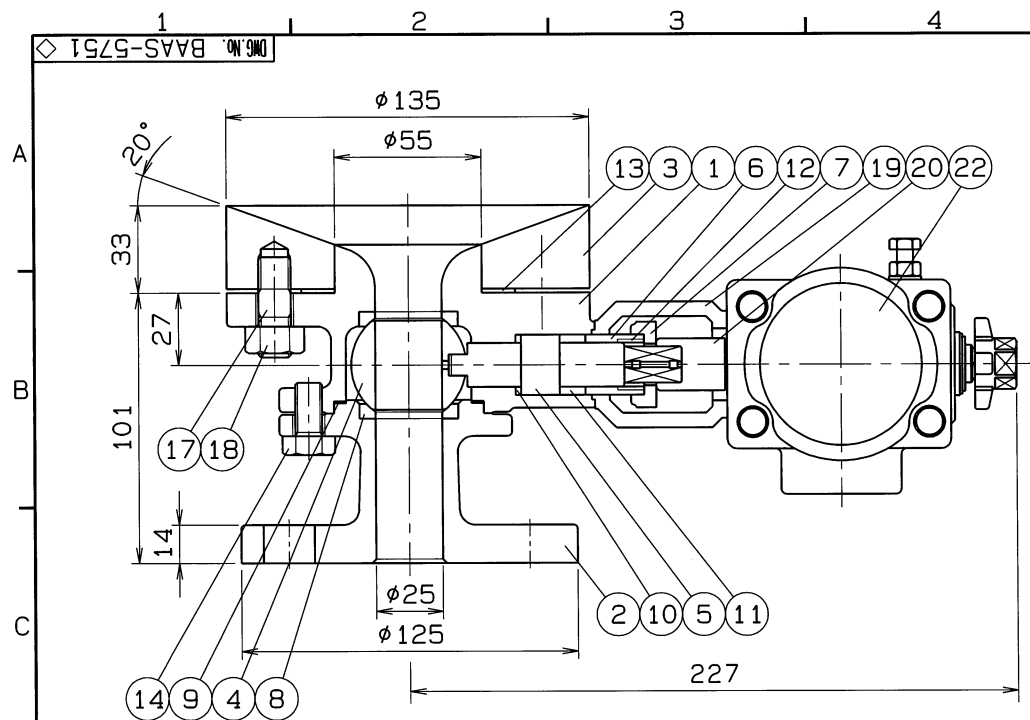

TANK PAD SIDE

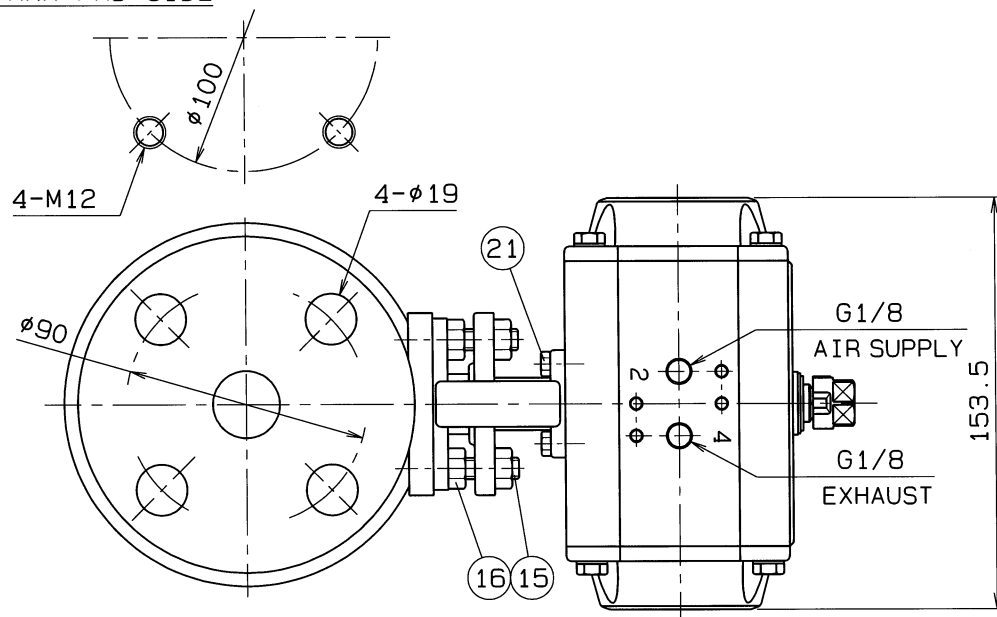

SPEC.		TEST PRESSURE	
FLUID	清水	SHELL	HYDRO 2.1 MPa
PRESS.	1.0 MPa 以下	SEAT	AIR 0.6 MPa
TEMP.	常温		AIR MPa

注) 上記の流体条件と異なる場合
シリンダサイズが変更になる場合があります。

TORQUE CYLINDER

TYPE	AT101US08		
ACTION	SINGLE	OPERATION PROPERTY	ON-OFF
SUPPLY PRESSURE	0.4 MPa	HAND DEVICE	NOTHING

OPERATION

PORT2 AIR SUPPLY : LEFT TURN - VALVE OPEN
PORT2 AIR FAILURE : RIGHT TURN - VALVE SHUT

Q.TY :

END FLANGED : JIS B 2220

24	CAP HEAD BOLT	1	SUS 304	
23	INDICATOR	1	SCS 13	
22	TORQUE CYLINDER	1		
21	HEXAGON BOLT	4	SUS 304	
20	COUPLING	1	SCS 13	
19	BRACKET	1	SCS 13	
18	HEXAGON NUT	4	SUS 304	
17	STUD BOLT	4	SUS 304	
16	HEXAGON NUT	4	SUS 304	
15	GLAND BOLT	2	SUS 304	
14	BODY CAP BOLT	4	SUS 304	
13	PAD PACKING	1	P.T.F.E.	GLASS FILLED
12	STEM BEARING	1	P.T.F.E.	GLASS FILLED
11	GLAND PACKING	1SET	P.T.F.E.	
10	THRUST BEARING	1	P.T.F.E.	GLASS FILLED
9	GASKET PACKING	1	P.T.F.E.	
8	BALL SEAT	2	P.T.F.E.	GLASS FILLED
7	GLAND	1	SCS 13	
6	GLAND SLEEVE	1	SUS 316	
5	STEM	1	SUS 304	
4	BALL DISC	1	SCS 13A	
3	TANK PAD	1	SCS 13A	
2	BODY CAP	1	SCS 13A	
1	BODY	1	SCS 13A	

No.	NAME OF PARTS	Q.TY	MATERIALS	REMARKS
NAME	JIS 10K FLANGED END TORQUE CYLINDER OPE. TANK BOTTOM BALL VALVES			
TYPE	N-765HYS2	SIZE	25A	
DMG.No.	BAAS-5751	APPROVED BY	H. Ogura	
DATE	JAN. 22. 2020	CHECKED BY	H. Ogura	
SCALE		DESIGNED BY	R. Matsuki	
THIRD ANGLE PROJECTION METHOD		DRAWN BY	Y. Katayama	

O. N. INDUSTRIES LTD.

